

TECHNICAL ARTICLE

Experimental Studies of a Pulse Pressurisation Technique for Measuring Building Airtightness

Xiaofeng Zheng*, Edward Cooper†, Yingqing Zu‡, Mark Gillott*, David Tetlow*, Saffa Riffat* and Christopher Wood*

A pulse pressurisation technique is developed and utilised for determining building leakage at low pressure, based on a “quasi-steady pulse” concept. The underlying principle of the technique is to subject the building envelope to a known volume change in a short period of time (typically 1.5 s). The resulting pressure pulse is recorded, from which the leakage characteristic at low pressure is determined. The technique minimizes the effects of wind and buoyancy forces and has proven to be repeatable. It can use a compact and portable test rig and does not need to penetrate the building envelope. Therefore, it can obtain the leakage of a building very quickly and efficiently.

Throughout the various stages of research and development of the pulse technique, experimental investigations have been carried out under different configurations and scenarios in order to validate the changes that have been made for the purpose of system development and optimisation. This paper provides an overview of experimental investigations in the validation process by covering comparison between blower door and pulse unit, comparison between piston-based pulse unit and nozzle-based pulse unit, testing with multiple pulse units in a large building, testing with a known opening, and testing in different building types with a range of volumes and airtightness levels. It enables us to understand the strengths and the limits of the pulse technique, from the experimental and practical perspectives. A good repeatability level (within $\pm 5\%$) has been maintained throughout the various developmental stages and the average value of Q_{50}/Q_4 reported herein was in close agreement ($<1\%$) with that reported in a study based on a large database obtained across a number of countries. It was also proven feasible to measure the airtightness of large buildings using the pulse technique.

Keywords: Building airtightness; Blower door; Pulse technique; Experimental validation

1. Introduction

As concerns related to carbon emission and climate change grow gradually, there has been increased focus on the energy use in the buildings. The energy consumption in the building sector contributes up to 50% of global energy consumption in the developed countries (Orme 2001). The relative proportion of energy losses associated with air infiltration has increased as the building thermal insulation has been improved over the last few decades. Airtightness fundamentally determines the level of infiltration occurring through building fabric and affects the building ventilation. The term, air leakage, defined as the air movement through cracks, gaps or other adventitious

openings in the building envelope, is also used to describe how well the building envelope is sealed. It has been widely acknowledged that building air leakage is a great contributor to building energy loss in regions where heating and cooling is required and it is important to measure it in the process of new construction and retrofitting in order to achieve good building energy efficiency, durability and indoor environment.

A good building airtightness is desirable considering the fact that building energy consumption caused by building infiltration takes 13%–50% of the overall heating energy, 4%–20% of cooling load (Emmerich 1999, Emmerich 1998, Jokisalo 2009, Raman 2014, Keast 1979, Ross 1978). The energy consumption in the building sector represents 33%–40% of global overall energy consumption (UNEP 2013, Lombard 2008, IEA 2013). However, the indoor air quality would compromise if the indoor contaminant is not diluted quickly enough by the infiltration. A purpose-designed ventilation strategy is required in this case in order to provide sufficient fresh air to occupants. Another significant factor, which is usually overlooked in comparison to energy consumption and indoor air quality, is the long-term effect caused by

* Architecture, Energy and Environment Research Group, Faculty of Engineering, University of Nottingham, University Park, Nottingham, UK

† Department of Architecture and Built Environment, Faculty of Science and Engineering, University of Nottingham, Ningbo, CN

‡ Department of Mechanics and Engineering Science, Fudan University 220 Handan Road, Shanghai, CN

Corresponding author: Xiaofeng Zheng
(xiaofeng.zheng@nottingham.ac.uk)

the moisture transportation that is largely influenced by the air tightness. A poor airtightness impacts the lifespan of building structure by allowing the unconditioned air to penetrate through building fabric, condense in the building envelope and deteriorate the building fabric. It also establishes a suitable environment for the growth of mould, which is potentially another source of contaminant to indoor environment.

One of the main challenges in measuring building air leakage lies in the measurement of the building pressure. Under natural conditions, a building would experience a pressure caused by wind and buoyancy effects, namely outdoor air movement and temperature difference between indoor and outdoor environment. This pressure is typically in the region of 1–4 Pa. It needs to be taken out from the measured pressure difference across the building envelope in order to obtain the actual building pressure. In reality, it can be difficult to achieve due to the random nature of wind. This issue becomes more outstanding when the wind condition is adverse. One of the approaches to overcome this issue is to measure the building leakage rate at high pressures in order to negate the impact of wind/buoyancy effects; this is adopted in the steady pressurisation method. One of them, known as blower door technique, has been well established and widely accepted as a means for measuring building airtightness. However, it comes with its own shortcomings, which have been discussed in scientific studies and practical uses (Cooper 2014, Cooper 2016, ZCH 2014, Okuyama 2012), mainly including: change of building envelope, demand of skilful training to the operative, unrealistic high measuring pressure and coarse interpretation of background pressure during testing especially under windy condition.

The historical development of the pulse technique for measuring airtightness consists of three versions, namely a gravity driven piston unit, a compressed air driven piston unit and most recently a nozzle unit. Overall, it has gone through several developmental stages related to algorithm optimisation, system simplification and reconfiguration changing from a cumbersome and heavy unit into a more portable and quick-to-use version. Experimental validations have also been carried out through those stages, in order to prove the concept initially, and validate changes made to the pulse unit, including hardware and firmware. Comparisons have been made experimentally between the piston unit and nozzle unit in order to verify the validity of

the replacement of piston with nozzle. The pulse unit has also been used to measure the size of known openings in a real house, and the air leakage characteristic of a number of UK residential buildings in different types alongside the steady test method to compare in measuring known openings and how these two methods correlate with each other in a range of UK domestic buildings. Tests in large buildings using multiple piston and nozzle units are also introduced to show the technical feasibility of testing large buildings. This series of experimental studies allow us to understand the pulse technique comprehensively.

2. Current State of the Art

Current standard approach for measuring building airtightness is the steady fan pressurisation method; the well-known one is the blower door. It is widely established that the steady pressurisation method has provided a convenient means for testing and comparing the airtightness of buildings for many years. It measures the building leakage in a range of high pressures, typically 10–60 Pa. The test is implemented by creating a steady pressure difference across the building envelope and simultaneously measuring the corresponding airflow through the fan that is used to exert the airflow. In practice, this can be achieved by using a fan blower, which is mounted in an external doorway (originally in a window opening), as shown in **Figure 1** (Pressurisation mode).

It works by blowing air into the building enclosure or drawing air out of it to create a pressure difference across the envelope and the corresponding airflow rate is recorded. The pressure difference across the building envelope is measured by a pressure gauge and the flow rate through the building envelope is measured by a flow meter. The leakage-pressure correlation is used to establish the building leakage characteristic. A correlation curve of a typical steady state airtightness test is shown in **Figure 2**. The building air leakage in many regions is quoted at elevated pressures such as 50 Pa in the UK (**Table 1**), which is much higher than the 1–4 Pa range pressure difference experienced by buildings under natural conditions. Using elevated pressure such as 50 Pa means that the noise pressure caused by wind or buoyancy effects can be minimised and hence provide good repeatability. However, concern has also been expressed over the accuracy of predicting the leakage at normal pressures due to non-linear effects such as valving effect

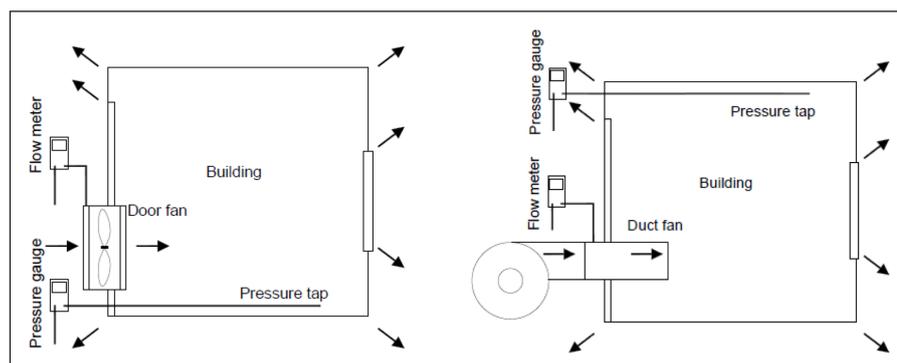


Figure 1: Steady state airtightness method (door fan and duct fan: in pressurisation).

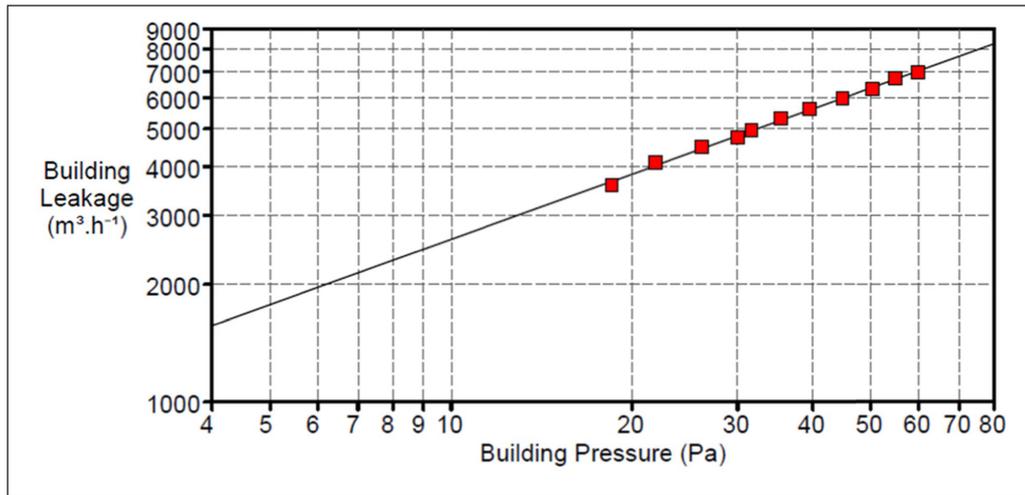


Figure 2: A typical steady state airtightness test (Log-log plot).

Table 1: Developmental stages of the pulse technique.

Developmental stage	1 (2002)	2 (2002–2011)	
Photo or schematic diagram			
Developmental stage	3 (2010–2013)	4 (2013–2015)	5 (2016–2017)
Photo or schematic diagram			

induced at high pressures in some occasions, which was recently reported by Cooper (Cooper 2016).

This technique was firstly used in Sweden around 1977 (Sherman 2004, Anderson 1995) as a ‘blower window’ by Ake Blomsterberg, who then continued his research in Princeton University in 1979. This paved a foundation to wider developments and acceptance of blower door test. The initial utilisation was started by researchers who used it to understand building infiltration. With the assistance of blower door, researchers discovered that hidden leak accounted for a significant amount of air leakage, which was seen as a great leap forward in understanding how buildings operate. Blower door was also seen as a useful tool for weatherization and retrofitting work. Since then it has attracted wide attention and generated high demand in building industry. Companies started to form and manufacture blower door units. In 1986, 13 blower door

manufacturers were identified by Home Energy in United States, but with only three manufacturers still in the business today: Retrotec, Minneapolis and Infiltec. The blower door technology has gone through significant developments from early bulky, heavy and clunk version, which was made of materials like plywood and Formica to the latest lighter and more compact version made of adjustable metal frame and lightweight fabric door panel with advanced instrumentation. The test duration has also been reduced significantly.

A large number of scientific research related to the blower door technology has been carried out, covering unregulated or temperate/hot climate countries (Ji 2017, Ji 2017, Salehi 2017), modelling/infiltration (Prignon 2017, Baracu 2017), building characterization (Guyot 2016, Moller 2010, Mattsson 2007, Nishioka 2003), retrofitting (Sinott 2012), measurement uncertainty (Sherman 1995),

indoor air quality (Howieson 2014) and other relevant aspects (Guyot 2016, Furbringer 1988). However, the technology comes with its own shortcomings, which include change of building envelope, unrealistically high testing pressure, coarse interpretation of wind effect and demand for skilful training. That was one of the early motivations for finding alternative methods for measuring building airtightness, such as AC method (Moller 2010, Card 1978, Watanabe 1978), decay method (Mattsson 2007, Granne 2001, Nishioka 2003), Pulse method (Carey 2001, Cooper 2004, Cooper 2007, Cooper 2014, Zheng 2017, Lee 2011, Bae 2013) and acoustic method (Ringger 1989, Keast 1979, Sherman 1988, Lordache 2012, Sonoda 1986, Benedetto 1981, Hassan 2013).

3. Principle and Historical Development

The pulse technique measures the building airtightness at low pressures by releasing a known volume of air into the test building over 1.5 seconds from an air tank to create an instant pressure rise within the test building and reach a 'quasi-steady' flow. Pressure variations in the building and tank are monitored and used for establishing a correlation between leakage and pressure. The method used for the adjustment, which accounts for changes in background pressure, is achieved by deducting background pressure from the raw data. This is described in a previous paper (Cooper 2007). A typical pulse test measurement is shown in **Figure 3**. The readings of building pressure consist of three key stages, pressure variation during quasi-steady period and background pressures before and after the pulse.

The pulse technique measures the building leakage at various pressure levels similar to leakage measurements using a blower door test process. However, it measures in a dynamic manner instead of taking each individual reading at a steady pressure level. The advantage of this technique is that the test can be done in 11–15 seconds. The challenge lies in the occurrence of the inertia effect of air that flows through openings, which then adds uncertainty to the measurement (Sharples, 2005). This type of flow is addressed herein as unsteady flow. The percentage of unsteady flow in the quasi-steady period, isolated and evaluated using a momentum equation, is used to account for that inertia effect. The momentum equation is described by eq.(1).

$$\Delta p\{t\} = aq\{t\}^2 + bq\{t\} + \rho_i \frac{I_e}{A} \frac{dq}{dt} \quad (1)$$

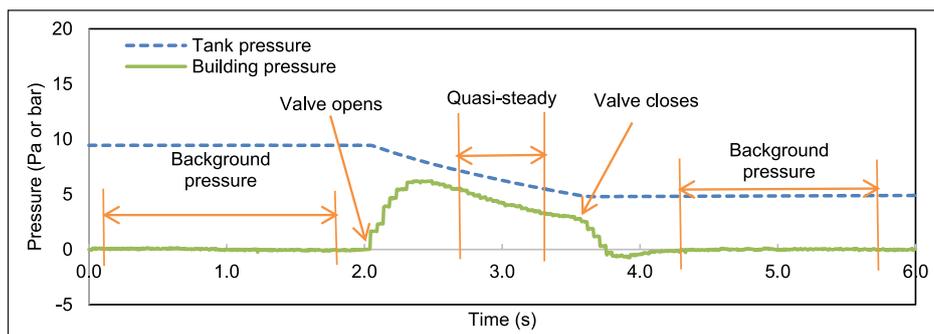


Figure 3: A typical pulse test by a unit with 60 l tank (tank pressure measured in bar, building pressure in Pa).

The first two terms of the right hand side of eq.(1) correspond to the momentum change and surface friction. The third term accounts for the inertia effect of the air that flows through the opening.

Table 1 lists a summary of the pulse unit at each developmental stage with a schematic diagram or a photo of each version. As can be seen the initial process involved the delivery of a Pulse of air through the use of a moving piston inside of a large cylinder. This method was superseded by the use of a nozzle attached directly to an air compressor tank. This enabled the removal of the large piston, but the nozzle method necessitates the need to measure the tank pressure throughout the test to determine a volumetric flow rate from the tank. The validity of this process has been shown to be accurate and repeatable as introduced in section 5.1 and further details are reported by Cooper (Cooper 2014). More technical details of each iteration are listed in **Table 2**.

The work reported in this paper focuses upon experimental investigations utilising pulse units developed at stage 2–5 i.e. no discussion in relation to gravity driven piston unit.

4. Methodology

4.1. Case study buildings

All the buildings that were tested in these experimental studies are shown in **Figures 4** and **5**. The ones in **Figure 4** are dwellings except No.10, which has a size similar with dwellings. All are listed in the format of House Number-House type. The key parameters of the test houses are listed in **Table 3**.

Three non-residential buildings, as shown in **Figure 5**, were used for testing to explore the feasibility of measuring the airtightness of large buildings using the Pulse technique.

Prior to testing, all the buildings were prepared according to the UK's Air Tightness Testing and Measurement Association's Technical Standard L1 (ATTMA TSL1) for measuring air permeability of building envelopes in dwellings (ATTMA, 2010). The blower-door tests followed the guidelines set out in ATTMA TSL1 and the BS EN:13829 (BSI, 2001), which has been superseded by BS EN ISO 9972. As such, the results should be comparable with those carried out for demonstrating compliance with the UK Building Regulations.

Table 2: System composition of the pulse unit at various developmental stages.

Stage	1	2	3	4	5
Version	Gravity driven piston unit	Compressed air driven piston unit	Nozzle unit		
Tank	N/A	Steel	Steel	Composite	Aluminum
Compressor	N/A	Oil based semi-industrial. 99 dB	Oil based semi-industrial. 99 dB	Oil free double piston 65 dB	Oil free double piston 65 dB
Solenoid valve	N/A	¾" 230 VAC	¾" 230 VAC	¾" 24 VDC	¾" 24 VDC
Tank pressure transducer	N/A	PMP 1400 (GE)	PMP 1400 (GE)	PMP 5013 (GE)	PMP 5013 (GE)
Building pressure transducer	N/A	200 Hz Furness control (FCO44)	200 Hz Furness control (FCO44)	20 Hz Furness control (FCO332)	20 Hz Furness control (FCO332)
Power supply	N/A	Standalone AC/DC converters	Standalone AC/DC converters	Embedded in a control box	Embedded in a control box
Pressure reference	N/A	External	External	Internal	Internal
Data collection	N/A	A/D converter and BNC box and computer	A/D converter and BNC box and computer	Self-contained RAM	Self-contained RAM
Data analysis	N/A	Computer-based Matlab program		Self-contained firmware	Self-contained firmware

**Figure 4:** Test houses (D: detached; SD: semi-detached; ET: end-terraced; MT: mid-terraced).

4.2. Experimental setup and test arrangement

Various versions of Pulse prototypes were used in the experimental studies, and the schematic diagrams of compressed air driven piston unit (stage 2) and nozzle unit (stage 3, 4 and 5) are illustrated in **Figures 6 and 7**, respectively. For the former, the electronic controller oper-

ates the solenoid valve by allowing it to be open for 1.5 seconds. The released air is injected to the cylinder to push the piston to the other side with a certain displacement. In this process, the instantaneous position of the piston, the internal and external pressure difference are recorded by CET (cable extension transducer) and pressure differential

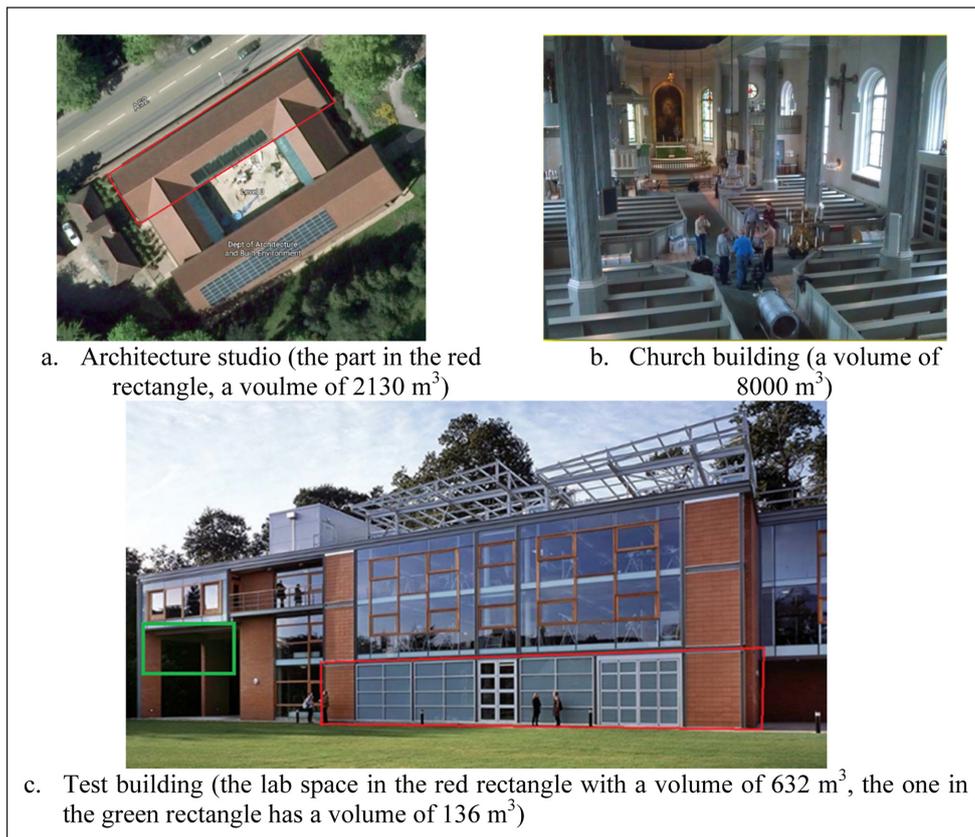


Figure 5: Buildings used for large building tests.

Table 3: Key parameters of the test houses.

House Number	Volume (m ³)	Age (years)	Position	Construction type	ACH ₅₀ (h ⁻¹)	Tank (l)
1	157	>100	End-terrace	Solid wall	12.1	40
2	196	>100	Mid-terrace	Solid wall	10.5	50
3	196	10–100	Semi-detached	Cavity wall	9.0	50
4	213	10–100	Semi-detached	Cavity wall	6.6	50
5	203	10–100	Semi-detached	Cavity wall	6.8	50
6	230	10–100	Detached	Cavity wall	8.5	50
7	447	10–100	Detached	Cavity wall	8.2	50
8	343	<10	Detached	Modern SIP	4.9	50
9	157	10–100	Semi-detached	Solid wall	9.0	50
10	371	>100	Semi-detached	Solid wall	7.6	50
11	194	10–100	Semi-detached	Cavity wall	8.3	50

transducer respectively, and sent to the BNC terminal box via A/D converter card, which allows high sampling rate. Records of data are taken at a frequency of 200 Hz.

For the latter, the schematic diagram is shown in **Figure 7**. The compressed air is released into the test building directly through a silencer mounted on the valve (V1) for 1.5 seconds. The silencer helps dispense the air more evenly with a reduced noise level. The subsequent pressure changes in the air tank and test building are respectively recorded by a pressure transducer and a differential pressure transducer (ΔP transducer) and sent to ATT control box for data analysis and storage. This setup does

not penetrate the building envelope by using an internal pressure reference tank and indoor setup. The valve (V2) on the internal pressure reference tank is normally open to have an equalised pressure with the ambient environment and it closes when the test starts to provide a useable pressure reference for the ΔP transducer to measure the building pressure response.

The experimental setups of all the studies are summarised in **Table 4** to provide details on the prototypes used for testing and the test buildings. The objective of each study is also given. Due to the fact the current version of Pulse unit is designed to test domestic buildings, most of the studies

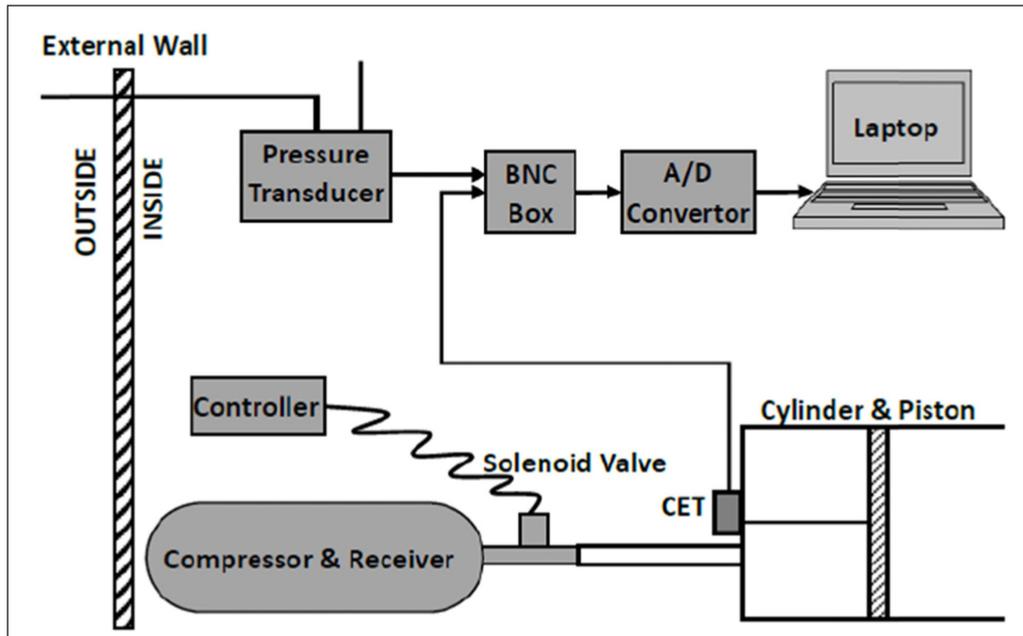


Figure 6: Schematic diagram of pulse technique using piston unit.

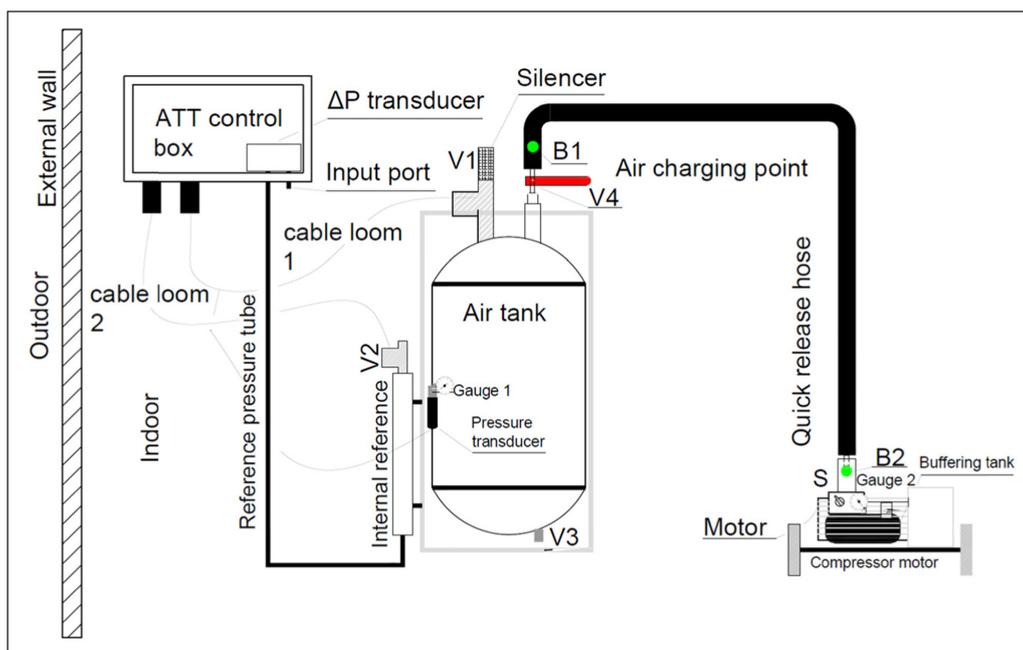


Figure 7: Schematic diagram and photo of the nozzle unit.

herein were carried out in dwellings or small non-residential buildings to validate each development, assess the repeatability and compare with the steady state method. Studies were also undertaken in a three large buildings with larger volumes to explore the feasibility of testing large buildings.

Studies from 5. 1 to 5. 4 were carried out to assess the repeatability of the prototype at each developmental stage. In each repeatability study, the prototype was subjected to repeated tests in a test space with a volume that is close to a typical dwelling. In 5. 1, a comparison was also made to the stage 2 piston unit and stage 3 nozzle unit to validate the feasibility of simplifying the delivery of building pressure change from piston movement to the release of compressed air through a nozzle. In the studies 6. 1 and 6. 2, the stage 3 and 4 nozzle units were compared

with Minneapolis blower door model 4 in a range of UK dwellings to see how the measurements, given by both methods at different pressure levels, correlate with each other. In the study 7, the impact of environmental conditions on the Pulse test had been investigated by monitoring the airtightness of a three-bedroom house that was subjected to various weather conditions over a year time. In the study 8, multiple Pulse units (stage 2 and 3) were tethered together to measure the airtightness of three buildings in different sizes, ranging from 632 m³ to 8000 m³.

5. Repeatability

During the course of research and development of the pulse technique, various changes in the system components and operations have occurred, such as the replace-

Table 4: Summary of the experimental setups.

Study (Section ID)	5.1	5.2	5.3	5.4
Unit	Stage 2 and stage 3	Stage 3	Stage 4	Stage 5
Test building	The meeting room in the green rectangle in Figure 5c	Building 1: same with 5.1. Building 2: Figure 4 (No. 8).	Same with building 2 in 5.2.	Same with building 2 in 5.2.
Objective	Validation and repeatability	Repeatability	Repeatability	Repeatability
Study (Section ID)	6.1	6.2	7	8
Unit	Stage 3 and 4	Stage 4	Stage 3 and 4	Stage 2 and 3
Test building	All the houses listed in Figure 4.	Same with building 2 in 5.2.	Same with building 2 in 5.2.	Buildings shown in Figure 5.
Objective	Comparison with the steady state method	Comparison with the steady state method	Environmental impact on the Pulse test	Testing Large building;

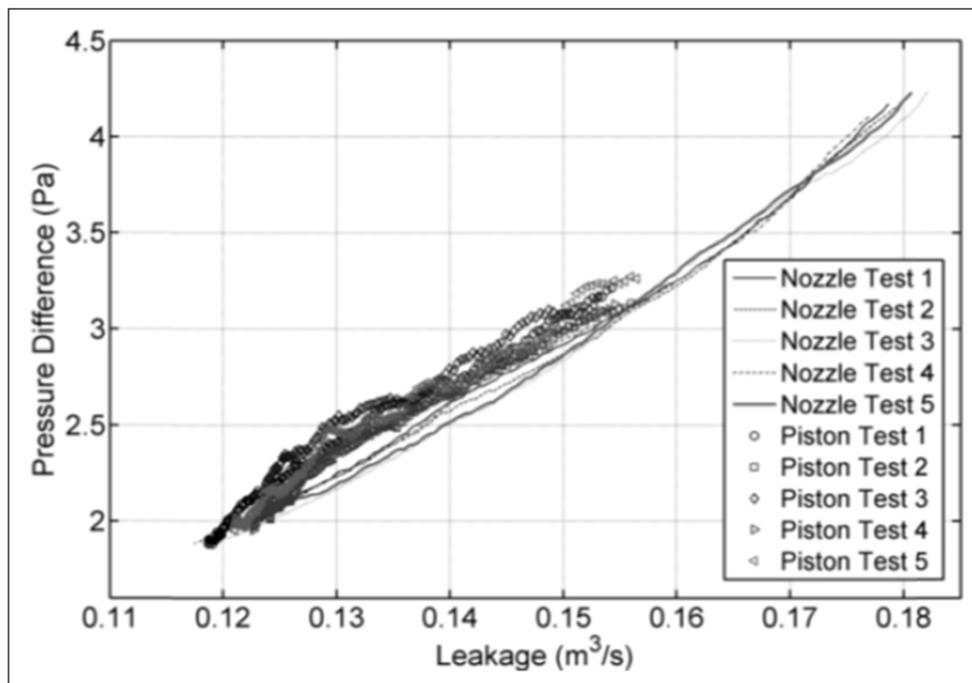


Figure 8: Comparison of nozzle and piston results.

ment of piston with nozzle, utilisations of differential pressure transducer with lower sampling rate, replacement of external pressure reference with internal pressure reference, utilisation of automated testing process, data collection and analysis. Considering repeatability is one of the key indicators of system reliability, it is important to maintain a good and consistent level of it throughout all the developments. Hence, experimental tests have been carried out at each stage to validate each change. Most of the tests were undertaken under calm or light wind conditions.

5.1. Comparisons with the piston technique

From the piston unit (stage 2) to the nozzle unit (stage 3), there is a significant change in the way of introducing the pressure pulse into the test space, i.e. replacing the compressed air driven piston displacement with direct ejection of compressed air into the building via a nozzle.

In the piston unit, the flow rate of released air is quantified by the real time movement of piston, while in the nozzle unit, it is done by monitoring the transient pressure change in the air tank. The consequent change in the mathematical model for determining the airflow rate from the tank, compared to the hardware or software modification based on the same principle, is more significant and hence more likely affects the system performance. Therefore, this section is allocated particularly to the investigation of the validity of this change by subjecting these two iterations to the same testing condition.

Tests were done in a meeting room (Figure 5c) and a comparison of pressure-leakage curves is shown in Figure 8. Good agreement appears and indicates that the nozzle unit is reliable for determining building leakage at low pressures. However, from Figure 8, it can be seen that the piston tests always give slightly lower values of leakage

under the same pressure differences. During the piston test, there is an unavoidable leak of air from the narrow gap between the piston and cylinder wall. Therefore, the piston test may underestimate the air leakage rate slightly because it is obtained indirectly from the velocity of the piston.

In addition to the single nozzle and single piston tests, further experimentation was also performed using simultaneous firing of two-nozzles or two-pistons, i.e. two nozzle devices or two piston devices operated at the same time to generate a combined pressure pulse, were used for the measurement. **Figure 9** shows the leakage characteristics of the same building obtained by the single nozzle, single-piston, two-nozzles and two-pistons with repeated test runs. A good agreement and repeatability were achieved as indicated by the same trend.

It was therefore concluded that the use of the nozzle technique was repeatable and obtained comparable results to that of the piston technique. In terms of function and portability, the nozzle unit also provided a significant advance of the pulse technique.

5.2. Nozzle unit (stage 3)

The stage 2 piston unit and stage 3 nozzle unit are described in details by Cooper (Cooper, 2007). They have been used to test two buildings based on the University Park campus in Nottingham, as shown in **Figures 5c** and **4**

(No. 8). Building 1 (**Figure 5c**) is a single cuboid room with a length, width and height of 9.20 m, 6.04 m and 2.45 m, respectively, which gives an internal volume of 136 m³. Building 2 (**Figure 4**) is a newly built energy efficient house, with three bedrooms on the first floor and one open space for kitchen, dining and living area on the ground floor. The total internal volume of the building is 371 m³. The test results are listed in **Table 5**, where V₄ is the air leakage rate at 4 Pa.

The system composition of piston unit and nozzle unit is almost the same except the different way of introducing the pressure pulse into the test building. The former does it by moving a piston driven by compressed air and the latter does it by releasing compressed air directly into the test house through a nozzle. As reported in 5. 1, the comparison between piston unit and nozzle unit have shown similar repeatability.

5.3. Nozzle unit (stage 4)

The Pulse technique evolved from a lab-based setup to a packaged unit with integrated electronics within a control box. In comparison to stage 2 and 3, the nozzle unit at stage 4 differs itself by:

- using a differential pressure transducer with 20 Hz sampling rate instead of 200 Hz;

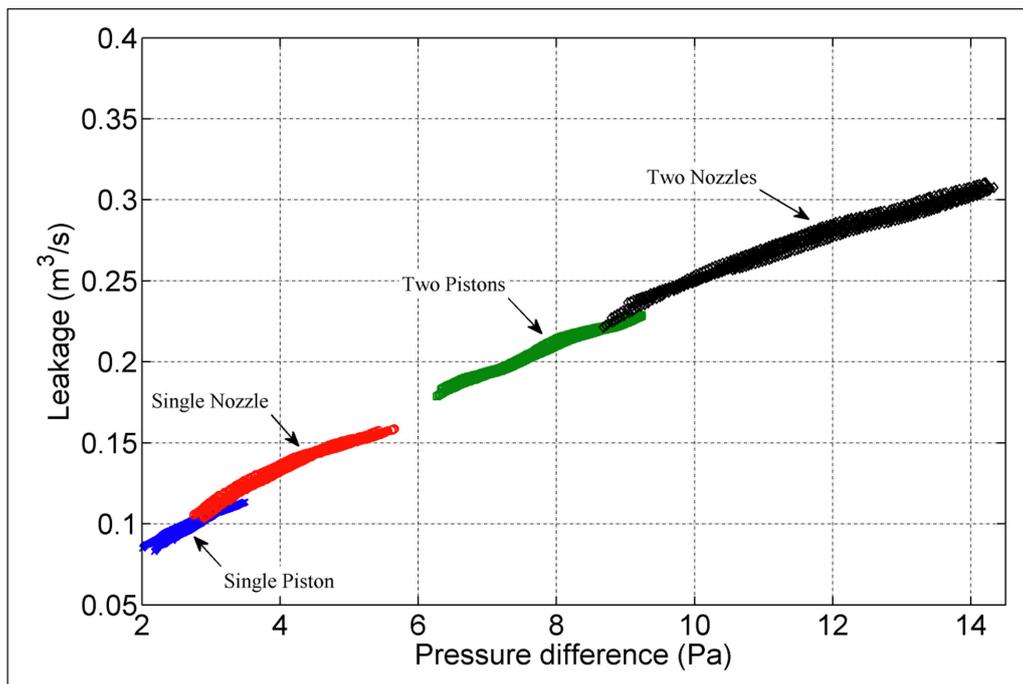


Figure 9: Comparison of the leakage measurement of the building obtained by nozzle and piston units.

Table 5: V₄ of 5 repeated test runs in two test buildings using the nozzle unit.

Building	Test ID	1	2	3	4	5	Mean
1	V ₄ (m ³ /s)	0.17535	0.17557	0.17704	0.17525	0.17668	0.175
	RPD (%)	-0.36%	-0.23%	0.60%	-0.41%	0.40%	98
2	V ₄ (m ³ /s)	0.13744	0.13762	0.13962	0.13858	0.13853	0.138
	RPD (%)	-0.66%	-0.53%	0.91%	0.16%	0.16%	36

Note: Mean and RPD stand for 'mean average' and 'relative percentage difference from mean' respectively.

- integrating the power supplies, BNC box, differential pressure transducer, A/D converter, data storage and analysis onto a PCB board in a single control box.

Table 1 shows how the laboratory-based equipment was refined to a self-contained control box. **Table 6** shows the results of 18 identical consecutive tests conducted in the house No. 8 (**Figure 4**) using a 40-litre stage 4 nozzle unit performed over a single day. The outside condition at the time of testing was categorised as light wind (0.45–1.34 m/s). The pressure-leakage relationship is represented in the table by a standardised leakage rate at 4 Pa, or V_4 (m^3/s). The value is derived from a curve fit to data taken directly at the low pressures. The repeatability is good, with most of the tests falling comfortably within $\pm 5\%$ of the mean V_4 . More details are reported by Cooper and Zheng (Cooper 2016).

In comparison to stage 2 and 3 pulse units, the repeatability of stage 4 pulse unit has decreased, which are a consequence of the two major changes i.e. the use of a differential pressure transducer with lower sampling rate (due to the consideration of cost) and the use of low grade power supply due to the need for system integration. The new power supply on the PCB board produces more electrical noise in the readings than the previous one. However, the repeatability is still within $\pm 5\%$, at an acceptable level.

5.4. Nozzle unit (stage 5)

During the experimental investigation using the stage 4 pulse unit, a number of practical concerns were noted. They include:

- The overall weight is around 40 kg relying on two people lifting between different levels.

- Condensation formed and accumulated at the port where the tank pressure transducer is installed.
- Some pressure tube is exposed and prone to be affected by external forces such as reflected airflow or manual operation.
- The unit does not have a casing that could protect it during transportation and onsite operation.

Accounting for the issues described above, some re-configurations were made in the stage 5 pulse unit to

- Split the pulse unit into two main parts, with the air tank being separated from the compressor module, both of which are within a single person-handling limit, 25 kg.
- Relocate the pressure transducer to the top of the tank.
- Replace the composite tank used in the stage 4 pulse unit with a 60-litre aluminium tank.

In the following tests, a 60-litre stage 5 nozzle unit alongside a 80 litre stage 4 nozzle unit were used in a three bedroom detached house. The results are listed in **Table 7** showing the 60-litre stage 5 pulse unit has maintained a similar level of repeatability with the stage 4 pulse unit. The mean value of air permeability at 4 Pa measured by both units is in close agreement, with a 3.1% percentage difference.

6. Comparison with the Steady State Method

Although the pulse test is designed to take measurements of building air leakage at low pressures, it is frequently asked how the results obtained in the pulse test compare with that of the steady pressurisation test at 50 Pa, i.e.

Table 6: V_4 of 18 repeated test runs in a test house.

Test ID	1	2	3	4	5	6	7	8	9	Mean
V_4 (m^3/s)	0.117	0.119	0.122	0.120	0.118	0.118	0.124	0.124	0.115	
RPD (%)	-2.94	-1.01	1.47	-0.16	-1.55	-1.60	3.37	3.34	-4.39	
Test ID	10	11	12	13	14	15	16	17	18	0.120
V_4 (m^3/s)	0.123	0.121	0.123	0.119	0.116	0.116	0.125	0.119	0.123	
RPD (%)	2.59	0.48	2.47	-0.62	-3.44	-3.68	4.21	-0.62	2.18	

Note: Mean and RPD stand for 'mean average' and 'relative percentage difference from mean' respectively.

Table 7: Five repeated test runs in the test buildings using two different pulse units.

Pulse unit	Test ID	1	2	3	4	5	Mean
Stage 4	V_4 (m^3/s)	0.1076	0.1048	0.1109	0.1077	0.1067	1.3351
	RPD (%)	0.07%	-2.57%	3.12%	0.17%	-0.79%	
Stage 5	V_4 (m^3/s)	0.1049	0.1126	0.1106	0.1153	0.1110	1.3763
	RPD (%)	-5.38%	1.56%	-0.25%	3.97%	0.10%	
							RPD (%) 3.1%

Note: Mean and RPD stand for mean average and relative percentage difference from mean respectively.

blower door test herein. The flow regimes at low pressure and high pressure levels are hydraulically dissimilar and therefore significant errors will occur in the prediction of air leakage rate from one level to the other in natural conditions, as reported by Cooper and Zheng in a field trial study (Cooper 2016). Hence, it is considered not possible to achieve a clear-cut comparison at 50 Pa between the two methods especially under natural conditions where the wind and buoyancy effects are difficult to eliminate. However, direct comparison at 4 Pa is possible to achieve in a sheltered environment where the wind and buoyancy effects are reduced and blower door is able to obtain accurate readings at low pressures. Initial findings showed that both methods provide measurements of Q_4 that are in close agreement under sheltered conditions. This was reported by Zheng and Cooper in 2017 (Zheng 2017). Hence, this section focuses on the experimental study in real houses.

6.1. Tests in a range of UK homes

In countries where the well-established airtightness standard sets the building air leakage at 50 Pa as a norm test, it might be difficult for the pulse technique to find its use in compliance test under current standard due to the reasons discussed above. However, it could be regarded as a useful tool for carrying out pre-compliance test, which makes indications to the contractor, or building quality control team if the dwellings are built to the level that is sufficiently airtight to pass the compliance test. Utilising pulse in this way therefore requires an interpretation of Q_4 measured by the pulse test to a value of Q_{50} , which is more familiar to many in the construction industry.

The ratio of Q_{50} measured by the blower door method to Q_4 measured by the pulse technique, Q_{50}/Q_4 , has been looked into in a series of experimental studies carried out in 16 buildings, mostly residential. The blower door unit used in this study is a model 4 Minneapolis blower door (BD-M4) and the pulse unit is a combination of stage 3

PULSE-50 and stage 4 PULSE-80, both gave tests in close agreement as reported by Cooper and Zheng (Cooper, 2016). The test buildings consist of 2 newly built homes and 14 existing buildings. Both testing methods were used to test each building under the same conditions on the same day.

Due to the uncertainty in extrapolation between low pressure and high pressure, both methods are not expected to agree perfectly. However, the results showed both followed the same trend (Cooper, 2016). In **Figure 10**, the Q_{50}/Q_4 ratio of most test houses lies in 4–6. Although the sample size of the test buildings in this study is very small, the average value of Q_{50}/Q_4 (5.26), represented by the red line in the figure, interestingly is in close agreement with the ratio (5.30). It is calculated using the average pressure exponent (0.66) in the power law equation obtained by steady state tests to a large sample size of dwellings in a number of countries reported by Orme (Orme, 1998). This might be because the type of the test buildings is similar to the ones reported by Orme. Nevertheless, the sample size of the test buildings needs to be increased in order to gain a more comprehensive and confident insights. In the figure, the annotation stands for house type, volume (m^3), age (years) and wall type. The abbreviations used in the annotation are explained in **Table 8**.

Table 8: Abbreviation table.

House or building type	Wall type
D: detached	CW: cavity wall
SD: semi-detached	SW: solid wall
MT: middle terrace	SIP: structural insulated panels
ET: end terrace	

'ET, 157, >100, SW' means it is an over 100 years old end terrace house with solid wall structure and internal volume of 157 m^3 .

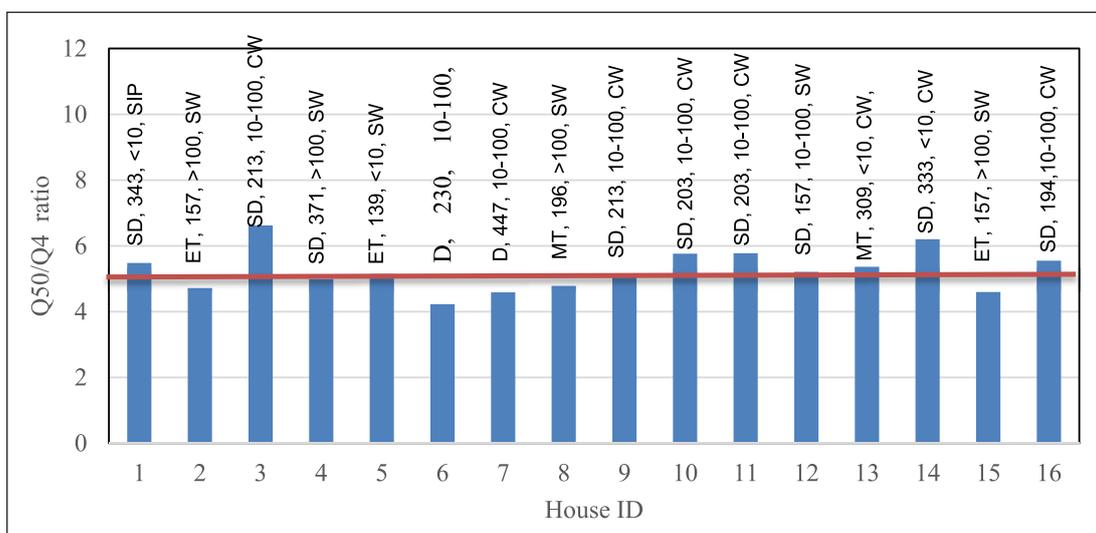


Figure 10: Q_{50}/Q_4 ratio of 16 test houses.

If 5.3 is used as the average Q_{50}/Q_4 ratio to interpret the pulse test result in pre-compliance test in countries where air leakage at 50 Pa is used in the standard, the prediction of Q_{50} to the 16 test buildings showed a deviation between 1% and 25% (**Figure 11**). Hence, this empirical ratio based calculation offers 56% chance of prediction of Q_{50} with $\pm 10\%$ accuracy in this case study.

6.2. Testing with a known opening increase

A simple check to see which technique is more accurate at measuring an added known opening under natural conditions is also presented. A short sharp-edged circular orifice with a diameter of 100mm was added into a window of a test house, as shown in **Figure 12**. Assuming an appropriate discharge coefficient of 0.61 therefore gives an effective leakage area (ELA) of $4.7909 \times 10^{-3} \text{ m}^2$. Tests were conducted for both techniques, BD-M4 and stage 4 PULSE-80 with and without the added opening. The increase in leakage rate measured by both techniques was then converted to an effective leakage area using eq.(2) and compared to the known opening, as shown in **Table 9**.

$$ELA = V \sqrt{\rho / 2P} / 0.61 \tag{2}$$

Where, V is the air leakage rate (m^3/s), ρ is the air density (kg/m^3), and P is the building pressure (Pa). It can be seen

that the measurement made by the pulse unit is relatively closer to the known effective area than the blower door measurement in most tests. However, these tests were conducted in natural conditions where environmental factors were not eliminated; hence, there is a level of uncertainty. Therefore, the tests in this section are only for obtaining preliminary insight into comparison of testing accuracy and no solid conclusion should be drawn from them.

7. Repeatability of Tests under different Environmental Conditions

This section investigates the impact of environmental conditions, including indoor/outdoor air temperature, wind speed and direction, to the building airtightness. A recent study (Remi 2016) shows an uncertainty of 6%–12% can be caused by wind speeds of 6–10 m/s combined with other sources of error in a steady state test at 50 Pa. Given the low operating pressure of the pulse unit, the wind condition can be considered the foremost important environmental factor for consideration due to its direct impact on the building pressure.

The investigation was performed by conducting a number of tests on the house No. 8 in **Figure 4** over a period from September 2014 to September 2015. This period covered the summer, autumn and winter seasons, which provided test scenarios with various wind conditions and

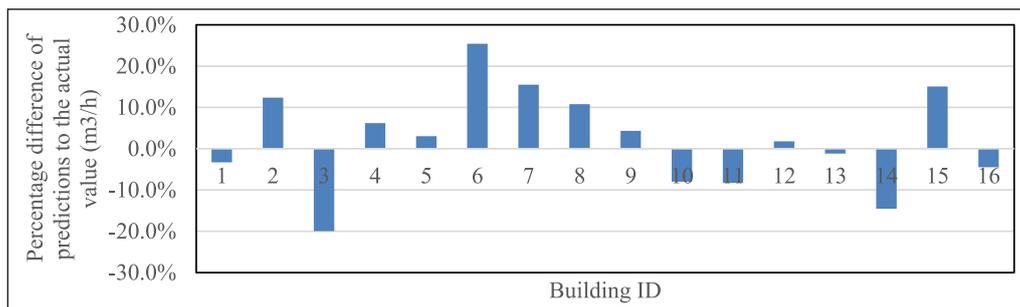


Figure 11: Percentage difference of predictions of Q_{50} to that measured by BD-M4.



Figure 12: Setup of the known opening in house No. 8.

Table 9: Results of other known opening tests using the blower door and stage 4 unit.

Test ID		Test 1	Test 2	Test 3	Test 4	Test 5
BD-M4	V_4	-2.9%	16.5%	146.7%	-71.3%	27.1%
PULSE-80	V_4	4.77%	-3.47%	32.1%	9.7%	5.1%

V_4 stands for air leakage rate at 4 Pa. For BD, V_4 is extrapolated from blower door test. For PULSE-80, it is measured directly.

outdoor temperatures ranging from 7°C to 21.5°C. Due to the development of the prototype, three versions of prototypes with tanks in two different sizes were used for these monitoring tests; the full details are listed in **Table 10**.

It can be seen from **Table 10** that the greatest influence upon the variation in Q_4 values appears to be due to wind speed and direction. Across all tests, the Q_4 values are within $\pm 8\%$ of the mean of all test runs. It must be noted that this variation, among other factors, might also include the difference that exists in different versions of prototypes.

8. Testing with Multiple Units in A Large Building

The original impetus of developing the pulse technique was to overcome the issues of testing the airtightness of large buildings using the steady pressurisation method, such as:

- Large amount of airflow is required to pressurise the building.

- Difficult to achieve even pressure distribution in the building.

The pulse technique was considered to show a significant advantage by testing at much lower pressure and therefore negates the need for large airflow delivery. The setup of multiple pulse units is also flexible and uniform pressure distribution can be obtained by setting up the units evenly in the building. Testing using multiple stage 2 units (piston) and multiple stage 3 units (nozzle) have been carried out in a number of large buildings in order to verify the technical feasibility.

The first one, as shown in **Figure 5a**, is a two-storey Environment and Education Centre (EEC) studio on Nottingham University Park campus, tested by four piston and four nozzle units respectively. During the tests, four differential pressure transducers were connected to the external and internal tappings with different locations. The studio, divided into 8 zones with wood boards, has a volume of 2130 m³. **Figure 13** gives the layout of the studio and the locations of the units.

Table 10: Results of repeated tests under different environmental conditions using stage 3 PULSE-50 and stage 4 PULSE-80.

Date	Prototype	T_o/T_{in} (°C)	Wind speed (m/s)	Wind direction	Q_4 (m ³ / h·m ²)	Sub-RPD (%)	RPD (%)
09-Sep-14	PULSE-50	16/20	1.57	SSE	1.014	0.52	2.70
16-Sep-14	PULSE-50	17/20	0.9	NE	1.065	5.58	7.87
26-Nov-14	PULSE-50	7/21.8	0.23	ENE	1.002	-0.67	1.49
12-Jan-15	PULSE-50	12/18	5.5	W	0.953	-5.44	-3.39
Mean Q_4 by PULSE-50					1.008		
17-Aug-15	PULSE-80	21.5/23.5	0.45	N	0.985	1.23	-0.24
24-Aug-15	PULSE-80	17/28.1	1.1	NNE	0.926	-4.79	-6.17
08-Sep-15	PULSE-80	17.8/18.1	0.23	ENE	0.997	2.46	0.98
10-Sep-15	PULSE-80	18/20.4	0.23	E	0.973	0.04	-1.40
18-Sep-15	PULSE-80	19/23	0.6	NNE	0.963	-0.99	-2.42
21-Sep-15	PULSE-80	14/18.2	3.2	SSE	0.993	2.05	0.57
Mean Q_4 by PULSE-80					0.973		
Mean Q_4 by PULSE-50 and PULSE-80					0.987		

T_o and T_{in} are outdoor and indoor air temperature. Q_4 is the air permeability at 4 Pa, m³/h·m².

MK0, MK1 and MK2 represent different stages of prototype development.

Sub-RPD represents the RPD of Q_4 of each test in a sub-group of tests (i.e. tests done by PULSE-50 or PULSE-80) against the mean value of the sub-group. RPD represents the relative percentage difference of Q_4 of each test against the mean Q_4 of all tests given by PULSE-50 and PULSE-80 combined.

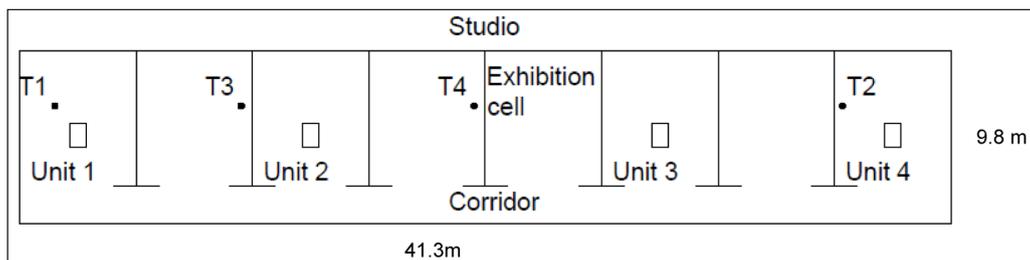


Figure 13: Floorplan of EEC Studio and locations of pistons/nozzles and internal pressure tappings (T1-T4).

Eight nozzle tests and five piston tests were carried out. Among them, nozzle tests 1~5 and piston tests 1~5 were operated with the maximum air tank pressure (around 10 bar); while, nozzle tests 6~8 were performed with unfully charged air tank to give the range of pressure pulse similar to that generated by pistons for comparison. The low-pressure leakages obtained by eight nozzle tests is shown in **Figure 14**. The repeatability of the experimental results is shown to be good, despite the strong wind at the time of testing.

The second building is a laboratory on the ground floor of Sustainable Research Building (**Figure 5c**) on the University Park campus. It has a regular cubic shape with a volume of 631.7 m³. Three-piston and three-nozzle tests were carried out and the leakage characteristics is shown in **Figure 15**. A good agreement has been achieved between tests using multiple units of both types.

Multi-piston tests on the third building- a church (**Figure 5b**) with a volume of 8000 m³ have been carried out together with research partners in Sweden. To determine the lower pressure leakage characteristic of the church, tests were carried out with 7 piston units

for generating pressure pulse and 2 differential pressure transducers for measuring the pressure difference across the building envelope. A number of tests have been carried out with vents sealed and unsealed. A few of them were invalid due to the strong wind condition during testing. However, for the valid tests, a good repeatability has been obtained in two testing scenarios as shown in **Figures 16 and 17**.

9. Conclusions

This paper provides a succinct overview of experimental validations testing throughout some of the key developmental stages of the pulse technique over the last 15 years. The pulse unit has gone through a development evolution from being a heavy and bulky unit to compact and easy to use version. Tests have shown that a good level of repeatability (within ±5%) has been maintained. Although being unable to provide direct comparison with blower door test under natural condition due to uncertainty in extrapolation, it was shown both methods have followed the same trend from dwelling to dwelling in side-by-side testing. Known opening tests under natural condition were carried out but no solid conclusion was drawn due to uncertain

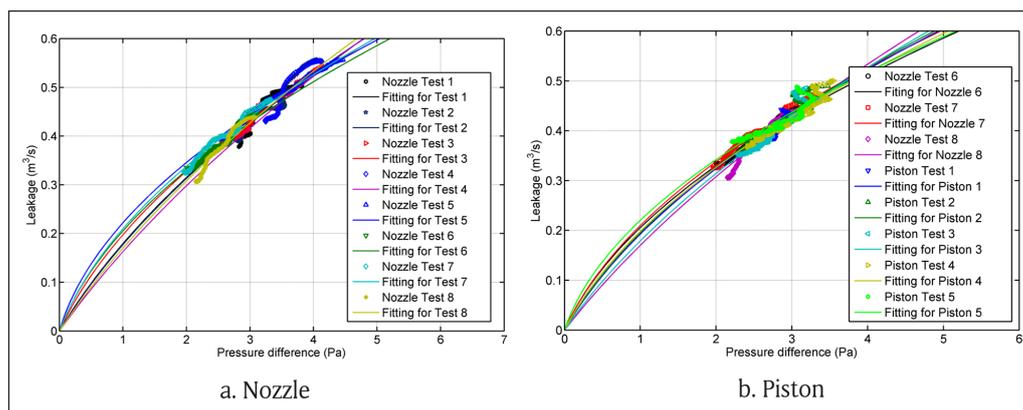


Figure 14: Leakage characteristic measured by piston and nozzle based pulse units.

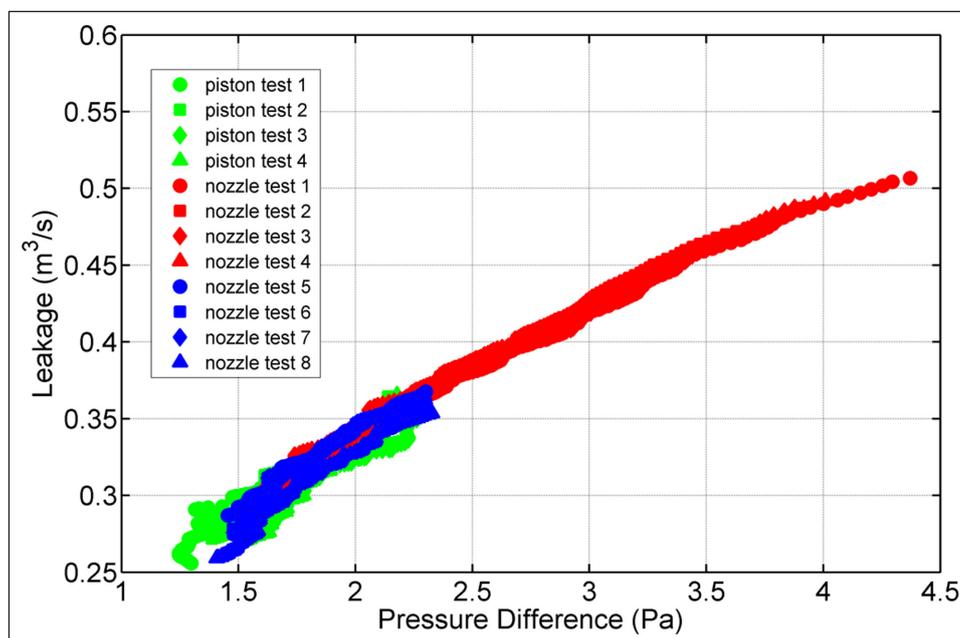


Figure 15: Comparison of results obtained by three nozzle units and three piston units.

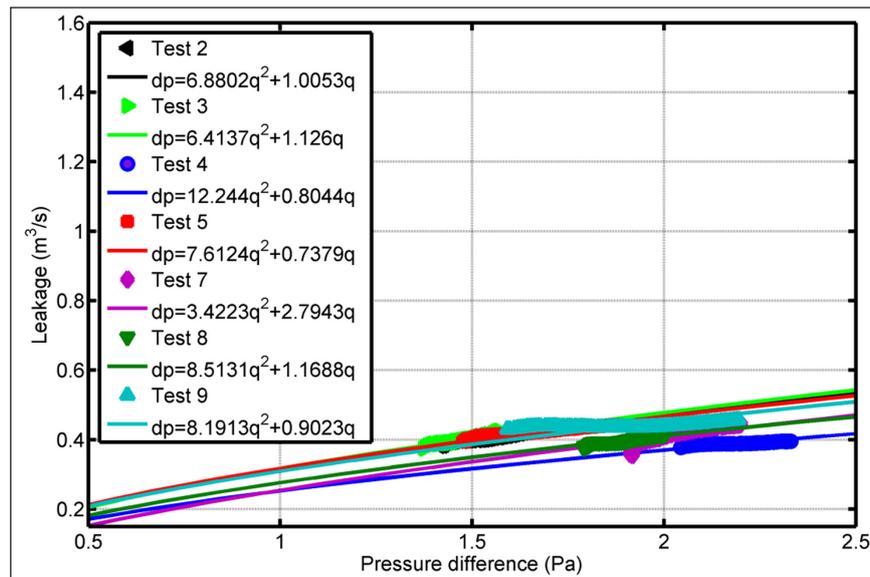


Figure 16: Leakage characteristic and power law fitting when vents were unsealed.

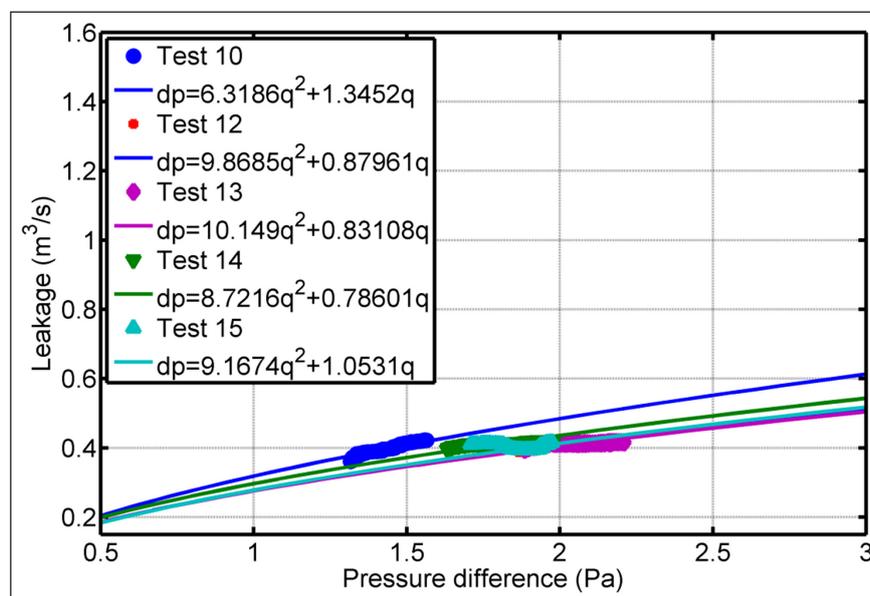


Figure 17: Leakage characteristic and power law fitting when vents were sealed.

environment factors associated with external environment. Testing using early multiple pulse units in large buildings have also been carried out and insight has been gained to the feasibility of testing large buildings. It was found that the pulse technique is able to test large buildings and provide results of good repeatability. However, it was also observed that the resilience of the pulse technique to wind effects was reduced in the large and less airtight buildings.

Acknowledgements

The authors gratefully acknowledge funding received from: the European Unions Horizon 2020 research and innovation programme under grant agreement No 637221. ['Built2Spec': www.built2spec-project.eu/]; the European Union's Seventh Programme for research, technological development and demonstration under grant agreement No 314283. [HERB: www.euroretrofit.com/]; the Innovate UK programme for 'Scaling Up Retrofit' under project No: 101609. ['PULSE': www.pulseairtest.com/], and EPSRC first

grant (EP/H023240/1) [A novel low pressure technique for measuring the air tightness of buildings].

Competing Interests

Saffa Riffat is the Editor in Chief for the journal *Future Cities and Environment*. He was completely removed from all editorial processes for this paper.

References

- Anderson, A.** 1995. The history of the blower door. Home Energy Magazine Online November/December 1995. <http://homeenergy.org/show/article/year/1995/id/1171>.
- Bae, S, Moon, H, Lee, MJ, Kim, N and Ryou, HS.** 2013. Improvement in the applicability of the air tightness measurement using a sudden expansion of compressed air. *Building and Environment*, 61: 133–139. DOI: <https://doi.org/10.1016/j.buildenv.2012.12.017>

- Baracu, T, Badescu, V, Teodosiu, C, Degeratu, M, Patrascu, M and Streche, C.** 2017. Consideration of a new extended power law of air infiltration through the building's envelope providing estimations of the leakage area. *Energy and Buildings*, 149: 400–423. DOI: <https://doi.org/10.1016/j.enbuild.2017.04.055>
- Benedetto, G and Brosio, E.** 1981. A relation between transmission loss and air infiltration characteristics in windows. Turin: Istituto Elettrotecnico Nazionale Galileo Ferraris, 1–4.
- Card, WH, Sallman, A, Graham, RA and Drucker, E.** 1978. Air leakage measurement of buildings by an infrasonic method. Syracuse University. Technical Report TR-78-1.
- Carey, PS and Etheridge, DW.** 2001. Leakage measurements using unsteady techniques with particular reference to large buildings. *Building Serv. Eng. Res. Technol.*, 22: 69–82. DOI: <https://doi.org/10.1191/014362401701524136>
- Cooper, EW and Etheridge, DW.** 2004. Measurement of building leakage by unsteady pressurisation. *25th AIVC Conference "Ventilation and retrofitting"*. Prague, Czech Republic, 15–17 September.
- Cooper, EW and Etheridge, DW.** 2007. Determining the adventitious leakage of buildings at low pressure. Part 1: uncertainties. *Building Serv. Eng. Res. Technol.*, 28: 71–80. DOI: <https://doi.org/10.1177/0143624406072330>
- Cooper, EW and Etheridge, DW.** 2007. Determining the adventitious leakage of buildings at low pressure. Part 2: pulse technique. *Building Serv. Eng. Res. Technol.*, 28: 81–96. DOI: <https://doi.org/10.1177/0143624406072331>
- Cooper, EW, Zheng, XF, Gillott, M, Riffat, S and Zu, YQ.** 2014. A nozzle pulse pressurisation technique for measurement of building leakage at low pressure. *35th AIVC Conference "Ventilation and airtightness in transforming the building stock to high performance"*. Poznan, Poland, 24–25 September page 236–243.
- Cooper, E, Zheng, XF, Wood, C, Gillott, M, Tetlow, D, Riffat, S and Simon, L.** 2016. Field trialling of a new airtightness tester in a range of UK homes. *International Journal of Ventilation*, 1–18. DOI: <https://doi.org/10.1080/14733315.2016.1252155>
- Emmerich, SJ, et al.** 1998. Impact of infiltration on heating and cooling loads in U.S. office buildings. *Department of Energy, Office of Building Technologies*. Agreement No. DE-AI01-01EE27615.
- Emmerich, SJ and Persily, AK.** 1999. Energy impacts of infiltration and ventilation in U.S. office buildings using multizone airflow simulation. *IAQ and Energy*, 98: 191–203.
- Furbringer, J, Roecker, C and Roulet, CA.** 1988. The use of a guarded zone pressurization technique to measure air flow permeabilities of a multizone building. 9th AIVC Conference "Effective ventilation". Gent, Belgium, 12–15 September.
- Granne, F.** 2001. Air and Water Tightness in Building Envelopes – Evaluation of Methods for Quality Assurance. Report R-01/187-SE (2001), Stockholm: KTH.
- Guyot, G, Ferlay, J, Gonze, E, Woloszyn, M, Planet, P and Bello, T.** 2016. Multizone air leakage measurements and interactions with ventilation flows in low-energy homes. *Building and Environment*, 107: 52–63. DOI: <https://doi.org/10.1016/j.buildenv.2016.07.014>
- Hassan, O.** 2013. An alternative method for evaluating the air tightness of building components. *Building and Environment*, 67: 82–86. DOI: <https://doi.org/10.1016/j.buildenv.2013.05.007>
- Howieson, S, Sharpe, T and Farren, P.** 2014. Building tight – ventilating right? How are new air tightness standards affecting indoor air quality in dwellings? *Building Services Engineering Research & Technology*, 35(5): 475–487. DOI: <https://doi.org/10.1177/0143624413510307>
- International Energy Agency.** 2013. Transition to Sustainable Buildings-Strategies and Opportunities to 2050. Available from: <http://www.iea.org/Textbase/npsum/building2013SUM.pdf>.
- Jokisalo, J, Krunitski, J, Korpi, M, Kalamees, T and Vinaha, J.** 2009. Building Leakage, infiltration, and energy performance analyses for Finnish detached houses. *Building and Environment*, 44: 377–387. DOI: <https://doi.org/10.1016/j.buildenv.2008.03.014>
- Keast, DN and Pei, HS.** 1979. The use of sound to locate infiltration openings in buildings. *Proceedings ASHRAE/DOE Conference "Thermal performance of the exterior envelopes of buildings"*. Florida, December 3–5. DOI: <https://doi.org/10.2172/6168258>
- Lee, MJ, Kim, N and Ryou, HS.** 2011. Air tightness measurement with transient methods using sudden expansion from a compressed chamber. *Building and Environment*, 46: 1937–1945. DOI: <https://doi.org/10.1016/j.buildenv.2011.04.001>
- Lombard, L, Ortiz, J and Pout, C.** 2008. A review on buildings energy consumption information. *Energy and Buildings*, 40: 394–398. DOI: <https://doi.org/10.1016/j.enbuild.2007.03.007>
- Lordache, V and Catalina, T.** 2012. Acoustic approach for building air permeability estimation. *Building and Environment*, 57: 18–27. DOI: <https://doi.org/10.1016/j.buildenv.2012.04.008>
- Mattsson, B.** 2007. A transient pressurisation method for measurements of airtightness. *Journal of Building Physics*, 31(1). DOI: <https://doi.org/10.1177/1744259107079021>
- Moller, EB and Rasmussen, TV.** 2010. A simplified method using compressed air to determine air leakage. ASHRAE.
- Nishioka, T, Chen, Q, Arai, N, Fujiwara, K, Umemiya, N and Okura, R.** 2003. Unsteady pressurization method to measure the airtightness of the building envelope. Available from: <http://www.irbnet.de/daten/iconda/CIB2449.pdf>.
- Okuyama, H and Onishi, Y.** 2012. Reconsideration of parameter estimation and reliability evaluation methods for a building airtightness measurement

- using fan pressurization. *Building and Environment*, 47: 373–384. DOI: <https://doi.org/10.1016/j.buildenv.2011.06.027>
- Orme, M.** 2001. Estimates of the energy impact of ventilation and associated financial expenditures. *Energy and Buildings*, 33: 199–205. DOI: [https://doi.org/10.1016/S0378-7788\(00\)00082-7](https://doi.org/10.1016/S0378-7788(00)00082-7)
- Orme, M, Liddament, M and Wilson, A.** 1998. “Numerical data for air infiltration & natural ventilation calculations”. *Technical Note 44, Energy Conservation in Buildings and Community Systems Programme, Air Infiltration and Ventilation Centre*, Coventry, 1998, page 1–108.
- Prignon, M and Van Moeseke, G.** 2017. Factors influencing airtightness and airtightness predictive models: a literature review. *Energy and Buildings*, 146: 87–97. DOI: <https://doi.org/10.1016/j.enbuild.2017.04.062>
- Raman, G, Chelliah, K, Prakash, M and Muehleisen, RT.** 2014. Detection and quantification of building air infiltration using remote acoustic methods. Australia: Internoise Melbourne, 16–19 November.
- Remi, CF and Leprince, V.** 2016. Uncertainties in building pressurisation tests due to steady wind. *Energy and Buildings*, 116: 656–665. 15th March 2016. DOI: <https://doi.org/10.1016/j.enbuild.2016.01.029>
- Ringger, M and Hartmann, P.** 1989. Evaluation of an acoustical method for detecting air leaks. *Air Infiltration Review*, 11(1). December 1989.
- Ross, H.** 1978. ‘Air Infiltration’. *Lecture at Public Meeting, DoE, Division of Building and Community Systems, Architectural and Engineering Systems Branch*, 21 September 1978.
- Sharples, S, Closs, S and Chilengwe, N.** 2005. Airtightness testing of very large buildings: a case study. *Building Serv. Eng. Res. Technol*, 26(2): 167–172. DOI: <https://doi.org/10.1191/0143624405bt117tn>
- Sherman, MH and Chan, R.** 2004. Building Airtightness: Research and Practice, Lawrence Berkeley National Laboratory Report. Report No. LBNL-53356.
- Sherman, MH and Modera, M.** 1988. Signal attenuation due to cavity leakage. *J. Acoust. Soc. Am*, 84(6). December. DOI: <https://doi.org/10.1121/1.397062>
- Sherman, M and Palmiter, L.** 1995. Uncertainty in fan pressurisation measurements Airflow Performance Conference, ASTM International, West Conshohocken, PA, 266–283. DOI: <https://doi.org/10.1520/STP14701S>
- Sinott, D and Dyer, M.** 2012. Air-tightness Field Data for Dwellings in Ireland. *Building and Environment*, 51: 269–275. DOI: <https://doi.org/10.1016/j.buildenv.2011.11.016>
- Sonoda, T and Peterson, F.** 1986. A sonic method for building air-leakage measurements. *Appl Energy*, 22(3): 205–224. DOI: [https://doi.org/10.1016/0306-2619\(86\)90003-6](https://doi.org/10.1016/0306-2619(86)90003-6)
- UNEP.** 2013. Buildings and Climate Change, Summary for Decision-Makers. Sustainable Buildings & Climate Initiative, Available from: <http://www.unep.org/sbci/pdfs/SBCI-BCCSummary.pdf>.
- Watanabe, Y, Kobayashi, H and Utsumi, Y.** 1978. Development of validation of AC-pressurization measuring of leakage area of houses. Available from: http://www.ibpsa.org/proceedings/BS1999/BS99_PA-09.pdf.
- Zero Carbon Hub.** 2014. Closing the gap between design and as-built performance: End of term report, July 2014. Available from: http://www.zerocarbonhub.org/sites/default/files/resources/reports/Design_vs_As_Built_Performance_Gap_End_of_Term_Report_0.pdf.
- Zheng, XF, Cooper, E, Mazzon, J, Wallis, I and Wood, CJ.** 2017. A comparison study of the blower door and novel pulse technique on measuring enclosure airtightness in a controlled environment. *38th AIVC conference*, Nottingham, United Kingdom, 13–14 September 2017.

How to cite this article: Zheng, X, Cooper, E, Zu, Y, Gillott, M, Tetlow, D, Riffat, S and Wood, C. 2019. Experimental Studies of a Pulse Pressurisation Technique for Measuring Building Airtightness. *Future Cities and Environment*, 5(1): 10, 1–17 DOI: <https://doi.org/10.5334/fce.66>

Submitted: 19 November 2018 **Accepted:** 22 May 2019 **Published:** 26 June 2019

Copyright: © 2019 The Author(s). This is an open-access article distributed under the terms of the Creative Commons Attribution 4.0 International License (CC-BY 4.0), which permits unrestricted use, distribution, and reproduction in any medium, provided the original author and source are credited. See <http://creativecommons.org/licenses/by/4.0/>.

]u[*Future Cities and Environment*, is a peer-reviewed open access journal published by Ubiquity Press.

OPEN ACCESS 